


EXTERNAL FINISH INDICATIVE ONLY, HOWEVER IF USING BRICKWORK, BRICKS TO BE TIED AT 450mm VERTICAL CTRS & 750MM HORIZONTAL CTRS (NOT STAGGERED) USING STAINLESS STEEL WALL TIES SCREWED BACK TO FURRING STRIPS WITHIN EPS. LENGTH OF TIE TO SUIT WIDTH OF BRICKWORK

WOOD OR LVL LEDGER  
SELF TAPPING CONNECTOR  
SCREWS SUPPLIED BY (SIMPSON)

ICFLC-W HANGER

NOTE: THE USE OF ICFLC & LEDGER TO BE SPECIFIED IN ACCORDANCE WITH THE MANUFACTURERS LITERATURE

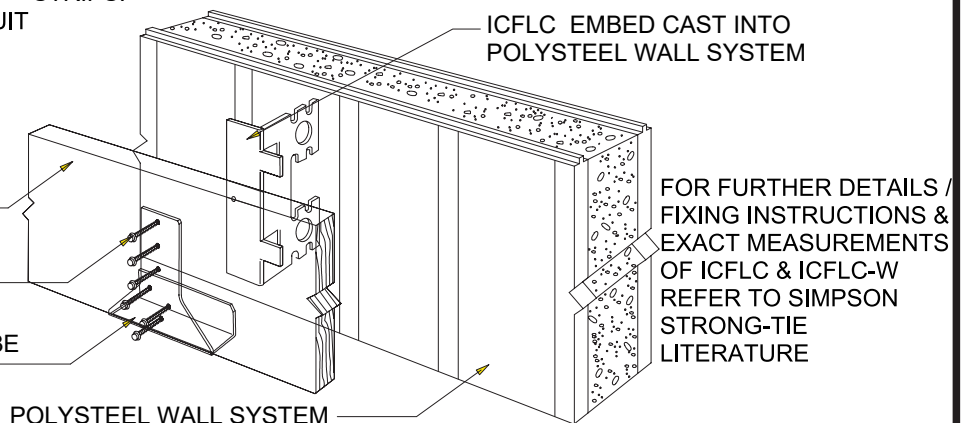

NOTE: ALTHOUGH IT MAY NOT BE NECESSARY FOR REINFORCEMENT TO BE INCORPORATED FOR STRUCTURES UP TO THREE STOREYS IN HEIGHT, STRUCTURES UP TO FOUR STOREYS AND INDIVIDUAL SITE CONDITIONS MAY DICTATE OTHERWISE & THEREFORE AN ENGINEER / ARCHITECT SHOULD BE CONSULTED IN THESE CIRCUMSTANCES. ALL DETAILS ARE TO CONSTRUCTED IN ACCORDANCE WITH CURRENT BUILDING CODES AND REGULATIONS. POLYSTEEL UK RESERVES THE RIGHT TO CHANGE INFORMATION SHOWN WITHOUT NOTICE

**POLYSTEEL**



**POLYSTEEL Floor to wall Jtn, type: Sep'ting wood joist floor indg. acoustic treatment.**

SCALE: Not to scale

APPROVED BY:

DRAWN BY: CSW

DATE: June 2005

REVISED: 08/03/19

Copyright 2005

DRWG. No.

**POLYSTEEL UK Ltd**

**05/DET09**

Tel: 01722 446 594

www.polysteel.co.uk